



Main

Range of product	Modicon Quantum automation platform
Product or component type	Power supply module
Power supply type	Summable

Complementary

Input voltage	48...60 V DC 48...60 V
Input current	<= 3800 mA
Inrush current	14 A 40 V
Input power interruption	13 ms 48 V
Associated fuse rating	2 A time-lag
Output voltage	5.1 V DC
Power supply output current	8 A summable
Output overvoltage protection	Internal
Output overload protection	Internal
Power dissipation	15.6 W
Alarm output	1 NC 6 A 220 V power supply fault
Local signalling	1 LED green power (PWR OK)
Marking	CE
Module format	Standard
Product weight	0.65 kg

Environment

Protective treatment	Conformal coating Humiseal 1A33
Standards	CSA C22.2 No 142 UL 508
Product certifications	CUL
Resistance to electrostatic discharge	4 kV contact conforming to IEC 801-2 8 kV on air conforming to IEC 801-2
Resistance to electromagnetic fields	10 V/m 80...2000 MHz conforming to IEC 801-3
Ambient air temperature for operation	0...60 °C
Ambient air temperature for storage	-40...85 °C

Disclaimer: This documentation is not intended as a substitute for and is not to be used for determining suitability or reliability of these products for specific user applications


Relative humidity	95 % without condensation
Operating altitude	<= 5000 m

Contractual warranty

Warranty period	18 months
-----------------	-----------

Racks for Modules Mounting

Dimensions of Modules and Racks

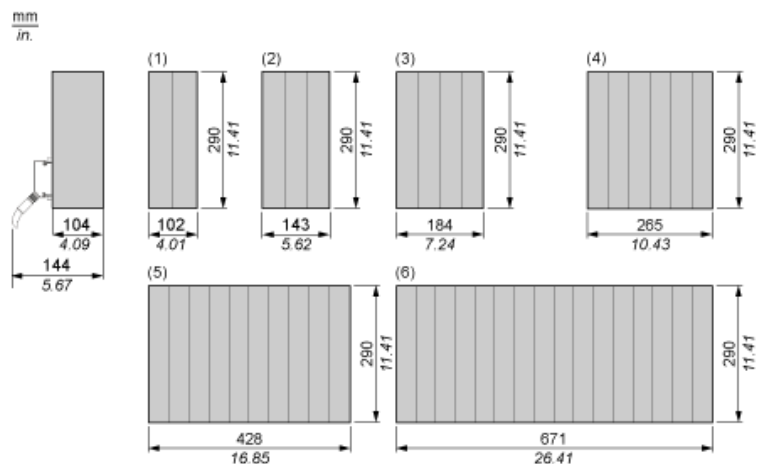


- (1) 2 slots
- (2) 3 slots
- (3) 4 slots
- (4) 6 slots
- (5) 10 slots
- (6) 16 slots

140CPS41400C


48 Vdc/8 A Summable Power Supply Module

Wiring Diagram

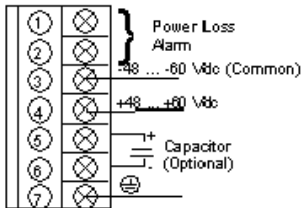

NOTE: A normally closed relay contact rated at 220 Vac, 6A / 30 Vdc, 5A is available on terminals 1 and 2 of the power terminal strip. This contact set may be used to signal input power OFF, or a power supply failure.

Operating Curve and Hold-up Capacitor Timing Chart

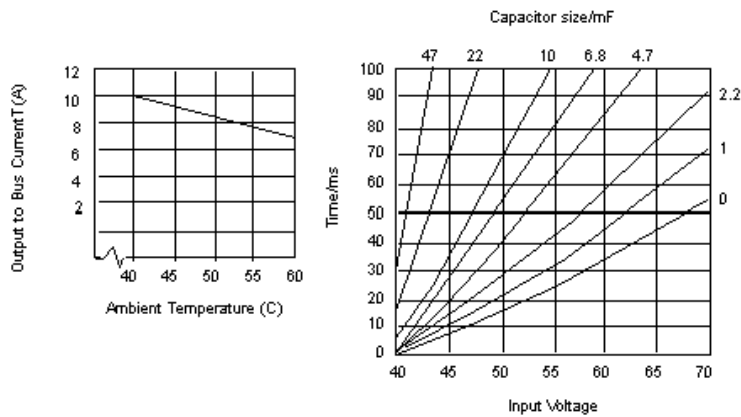

NOTE: Tolerance to input interruptions may be increased by adding a ≥ 80 Vdc electrolytic capacitor between 5 and 6 of the power terminal strip. Refer to the hold-up capacitor timing chart (above) for capacitor values.