



### Main

Range of product	Modicon Quantum automation platform
Product or component type	Power supply module
Power supply type	Redundant

### Complementary

Input voltage	48...60 V DC 48...60 V
Input current	<= 3800 mA
Inrush current	14 A 40 V
Input power interruption	13 ms 48 V
Associated fuse rating	2 A time-lag
Output voltage	5.1 V DC
Power supply output current	8 A redundant
Output overvoltage protection	Internal
Output overload protection	Internal
Power dissipation	17.2 W
Alarm output	1 NC 6 A 220 V power supply fault
Local signalling	1 LED green power (PWR OK)
Marking	CE
Module format	Standard
Product weight	0.65 kg

### Environment

Protective treatment	Conformal coating Humiseal 1A33
Standards	UL 508 CSA C22.2 No 142
Product certifications	CUL
Resistance to electrostatic discharge	4 kV contact conforming to IEC 801-2 8 kV on air conforming to IEC 801-2
Resistance to electromagnetic fields	10 V/m 80...2000 MHz conforming to IEC 801-3
Ambient air temperature for operation	0...60 °C
Ambient air temperature for storage	-40...85 °C

Disclaimer: This documentation is not intended as a substitute for and is not to be used for determining suitability or reliability of these products for specific user applications

---

Relative humidity	95 % without condensation
Operating altitude	<= 5000 m

---

### Contractual warranty

---

Warranty period	18 months
-----------------	-----------

---

Racks for Modules Mounting

Dimensions of Modules and Racks




- (1) 2 slots
- (2) 3 slots
- (3) 4 slots
- (4) 6 slots
- (5) 10 slots
- (6) 16 slots

140CPS42400C


48 Vdc/8 A Redundant Power Supply Module

Wiring Diagram

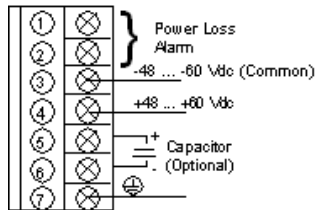

NOTE: A normally closed relay contact rated at 220 Vac, 6A / 30 Vdc, 5A is available on terminals 1 and 2 of the power terminal strip. This contact set may be used to signal input power OFF, or a power supply failure.

Operating Curve and Hold-up Capacitor Timing Chart

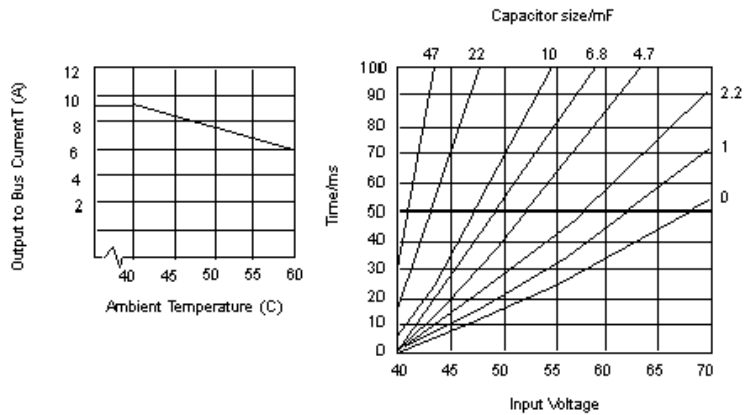

NOTE: Tolerance to input interruptions may be increased by adding a  $\geq 80$  Vdc electrolytic capacitor between 5 and 6 of the power terminal strip. Refer to the hold-up capacitor timing chart (above) for capacitor values.